


**Installation and Maintenance LPH Series**

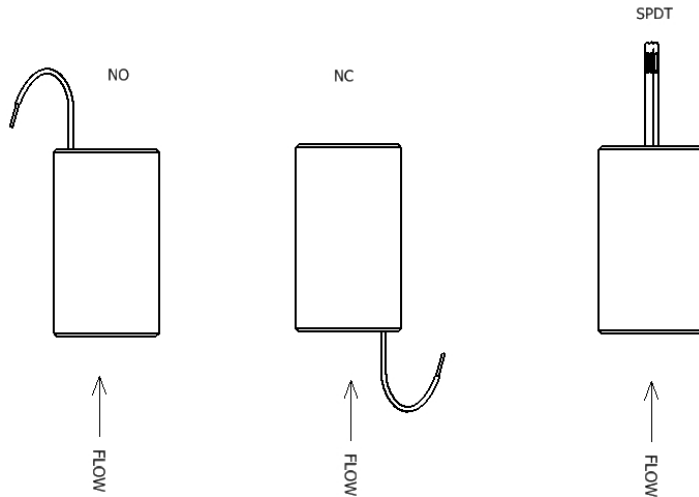

\\phcataog92418

Model	Size	Calibration	Material	Media	Switch	Options
LPH	125	0 thru 12	A-Acrylic	A-Air	NO	See catalog
	250	1 thru 8	B-Brass	W-Water	NC	
	375	1 thru 5	S-316S.S.		SPDT	
			T-Teflon			

**INSTALLATION**

Install the unit within 7 degrees of vertical. Do not over tighten fittings on the Acrylic units. Avoid Teflon tape, pipe paste or other foreign material from entering the unit. We suggest the use of a 10 micron filter. Ferrous metals, magnets and electromagnets will affect the operation of the unit. Use contact protection for longer reed switch life.

**MAINTENANCE**

By design, the LPH model is a low maintenance unit. If over time the bore becomes polluted or if the piston is not responsive to changes in flow, remove the retaining ring and magnetic piston and clean the unit using a suitable solvent. Use a swab to clean out the bore of the unit; wipe down the piston. Take extra care when reassembling the unit to reinstall the piston in the same orientation and replace the retaining ring.

**SWITCH CONFIGURATION**

Normally Open (N.O.) - Reed switch contacts are open with no flow and close on increasing flow

Normally Closed (N.C.) - Reed switch contacts are close with no flow and open on increasing flow

Single Pole Double Throw (SPDT); White- Common, Blue – Normally Open, Green – Normally Closed

This device is to be connected to an isolating source, such as a transformer, that has no direct connection to the primary circuit, other than through the grounding means, and can supply no more than 30VAC, 42VDC, 8A and 100VA.

SWITCH DATA	Single Pole Single Throw (SPST)	Single Pole Double Throw (SPDT)
Maximum Switching Voltage	250 VDC / 265 VAC	175 VDC / 120 VAC
Maximum Switching Current	1.5 A (DC) / 1.1 A (AC)	0.25 A (DC) / 0.18 A (AC)
Contact Rating	50 W (DC) / 50 VA (AC)	5 W (DC) / 5 VA (AC)

LPHIANDM12522

*\*Users are solely accountable for product selection, regardless of any recommendations or suggestions provided by ChemTec Equipment Company, Inc. Users should base product selection on their own analysis and testing to determine functionality and material compatibility in relation to their application. To ensure safe and trouble-free performance, it is essential to adhere to proper installation, operation, and maintenance procedures.*